



Bathing establishment fact sheet

Name of bathing establishment	ANGELO DI LEVANTE
Address	Viale Italice, 76
City	Forte dei Marmi (Lu)
Contacts	Tel. + 39 0584 881600 cell. + 39 3487793512 - info@bagnoangelolevante.it
Website	http://www.bagnoangelolevante.it/

TESTED BY: [Handy Superabile Social Promotion Association](#) in summer 2023

Please note The following information refers to the verification date shown at the bottom of each sheet. The Association is not responsible for any significant changes made to the property after the visit.

Summary

Bathing establishment fact sheet	1
Arrival at the facility	2
Private/public parking	2
Pathway from the parking lot to the main entrance	3
Reception welcome	3
Bar/restaurant	4
Internal pathways and common services	5
Internal pathways	5
Toilet and shower accessible to guests with reduced mobility	6
Changing room	7
Beach	8
Children's play area	9
Pool	10
Medical practices/health facilities	10

Project carried out with the contribution of






Arrival at the facility



Private/public parking

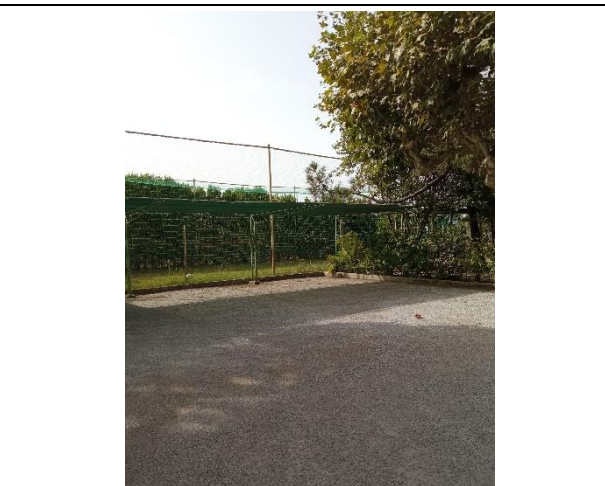Presence of private parking	YES
Fund type of private parking	gravel
Presence of parking space reserved for people with disabilities	YES
Public parking nearby	YES
Fund type of public car park	asphalt





Pathway from the parking lot to the main entrance

Pathway from the parking lot to the entrance	flat on a gravel surface which can make movement difficult for people in wheelchairs
There are indicators and tactile maps	NO
Useful width of door/entrance passage	greater than 90 cm
	

Reception welcome

Umbrella booking system	<input type="checkbox"/> Via the web <input checked="" type="checkbox"/> Via telephone <input checked="" type="checkbox"/> On site
Presence of multilingual staff	not detected
Presence of plant plan with legend of services available	NO
Presence of visuo-tactile map	NO








Noticeboard/information panels at an average height of 130 cm in a well-lit area and a character size of at least 14 dpi with a contrast ratio greater than 4.5:1	NO
The staff has undergone training on welcoming people with various disabilities	NO

Bar/restaurant

Type of venue	Bar/restaurant
Access to the venue	flat
Useful width of door/entrance passage	greater than 90 cm
Bar counter	116 cm
Type of tables	With 4 legged
Space under the floor tables	68cm
Multilingual menu	not detected
Menu with large print characters	NO
Braille menu	NO
Table service for people with disabilities	YES
Availability of food for celiacs	<input type="checkbox"/> bread <input type="checkbox"/> pasta <input type="checkbox"/> cookies <input type="checkbox"/> ice creams <input type="checkbox"/> pre-packaged foods



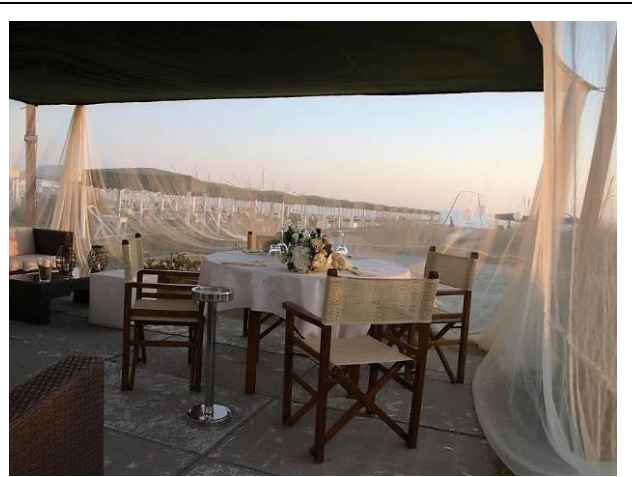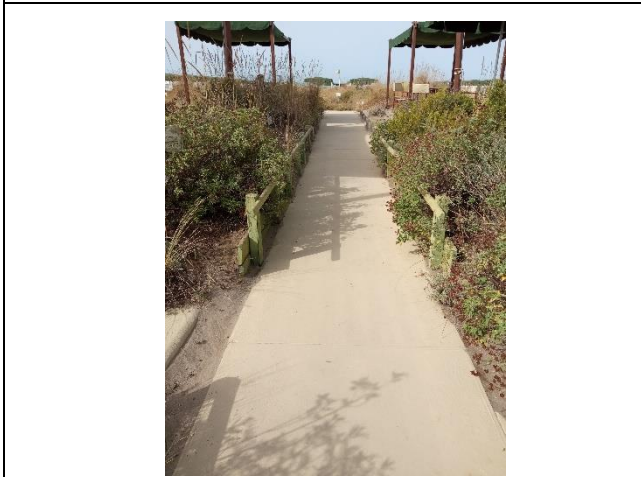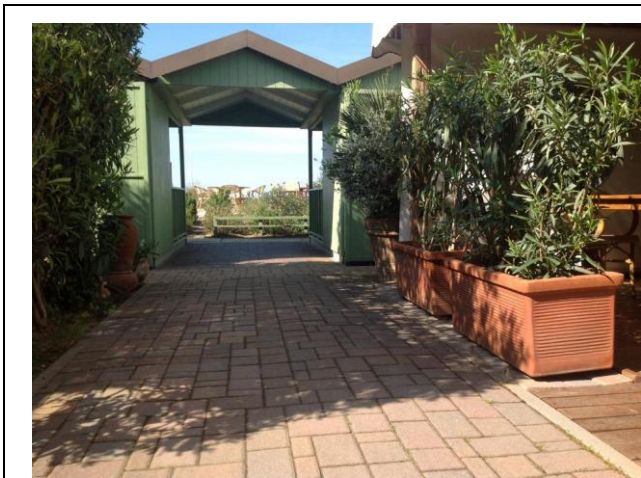

Internal pathways and common services



Internal pathways

<p>Indicate whether the pathways connecting the entrance to the beach are flat or with ramps in addition to those already described</p>	<p>obstacle-free routes</p>
---	-----------------------------





Toilet and shower accessible to guests with reduced mobility

Number of toilets accessible/usable by guests with reduced mobility	1
Access to the venue	flat
Useful width of entrance door	90cm
Toilet height	50cm
Open front toilet seat	NO
Support handles	on both sides
Flexible shower next to the toilet	NO
Free space on the sides of the toilet	to the left 20cm To the right greater than 90 cm front greater than 90 cm
Electric bell/telephone	YES
Washbasin with space underneath for a wheelchair	greater than 70 cm
Height from the ground to the lower edge of the mirror	not sufficient for use by people in a wheelchair
Baby changing table	not detected
	





Shower accessible to guests with reduced mobility available	YES separated from the toilet room
Access to the shower room if separated from the toilet room	with a step of 2 cm
Useful width of entrance door/gap if separated from the toilet room	greater than 80 cm
Shower type	open type
Floor-level shower	YES
Shower chair	missing
Support handle	missing
Presence of shower head or latch	fixed shower head
Electric bell/telephone	NO
	

Changing room



Changing room accessible to guests with reduced mobility available	YES
Access to the venue	with a 2 cm high step
Useful width of door/entrance passage	90cm
Dimensions of the changing room	sufficient for guest maneuvering in a wheelchair
Presence of cot	NO






Coat stand height from the floor	greater than 140 cm
----------------------------------	---------------------

Beach

Type of beach	sand
Access to the beach	flat
Walkway to reach the umbrellas	YES
Type of walkway	Concrete and wood
Walkway width	120 cm in concrete and 100 cm in wood
	
Removable Platform between the walkway and the umbrella station to facilitate the passage and parking wheelchair	YES
Amphibious beach chair available for helping people with reduced mobility to enjoy swimming (owned by the establishment or by association)	YES



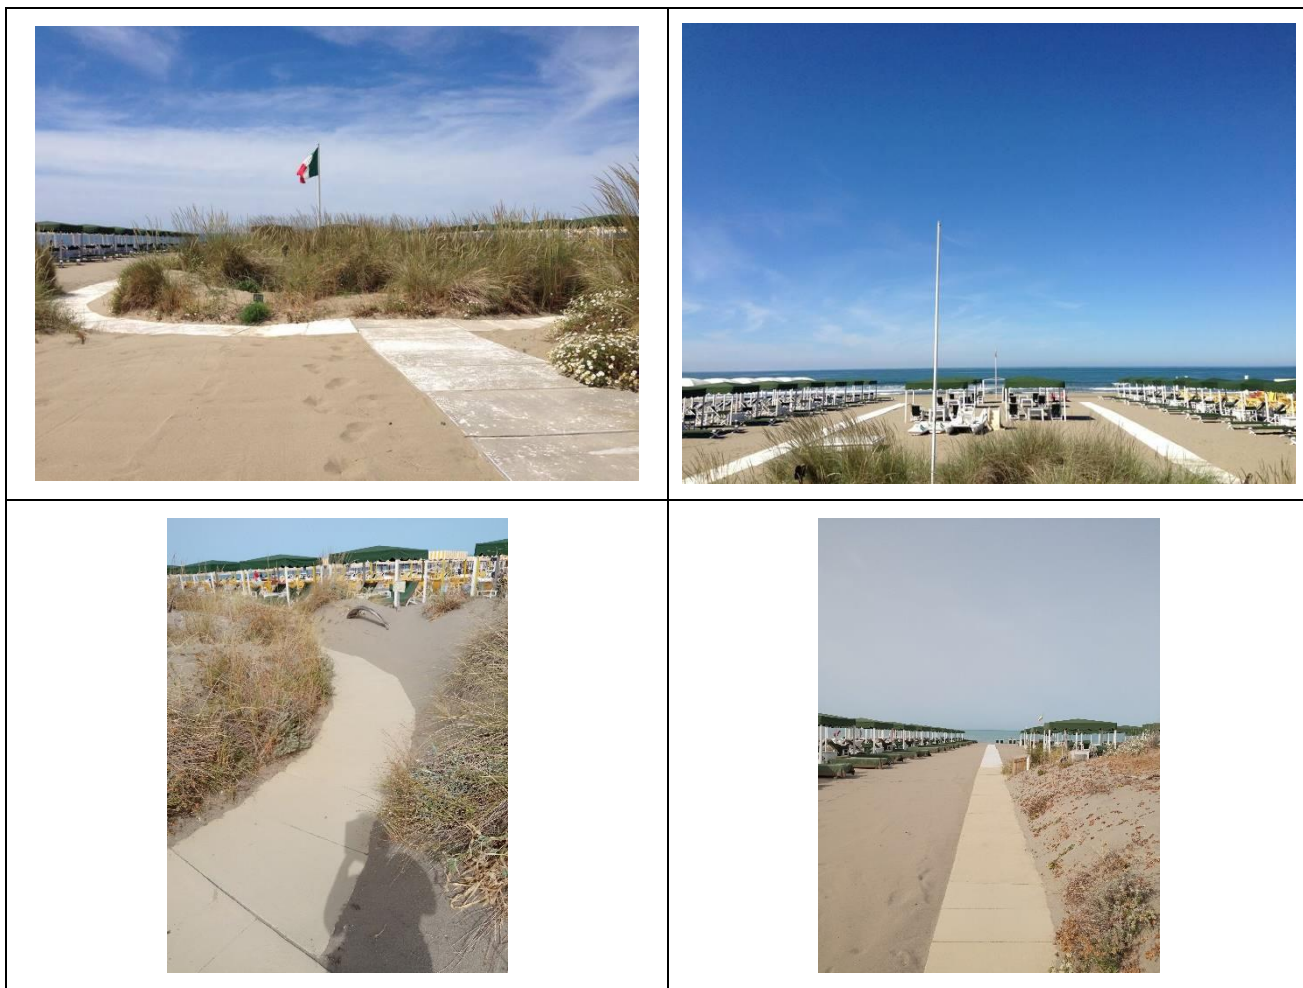


Children's play area

Children's play area	inaccessible to children with reduced mobility due to the presence of steps
----------------------	---





There are games for children with reduced mobility	NO
	Play area with table football and ping pong

Pool

The property has a swimming pool	NO
----------------------------------	----

Medical practices/health facilities

Hospitals near the facility	Versilia Hospital SS 1, 335, 55049 Camaiole LU Telephone: 0584 6051
Other healthcare facilities	ASL Health District No. 12 Viareggio Via Sant'Elme, 30 Tel. 058483873 Green Cross Viale Italico, corner. via Risorgimento Tel. 058484013 Free first aid for white codes Night medical guard Tel. 0584 83896 (8pm-8am) Mercy Via PI da Carrara, 32 Tel. 0584752133/0584 752149 Medical service "San Camillo" nursing home Via PI da Carrara, 37 Tel. 0584 7391



Project promoted by



Regione Toscana

	Dialysis service c/o Croce Verde Viale Italiceo, corner. via Risorgimento Tel. 058484013 affiliated with AUSL
--	--

TESTED BY: Handy Superabile - Social Promotion Association - in summer 2023

Project carried out with the contribution of



**Presidenza del
Consiglio dei Ministri**
Ministro per la disabilità